

# Distributed non-cooperative robust MPC based on reduced-order models

Long, Yushen; Liu, Shuai; Xie, Lihua; Johansson, Karl Henrik

2016

Long, Y., Liu, S., Xie, L., & Johansson, K. H. (2016). Distributed non-cooperative robust MPC based on reduced-order models. *Control Theory and Technology*, 14(1), 11-20.

<https://hdl.handle.net/10356/80618>

<https://doi.org/10.1007/s11768-016-5125-7>

---

© 2016 Springer International Publishing AG. This is the author created version of a work that has been peer reviewed and accepted for publication by *Control Theory and Technology*, Springer International Publishing AG. It incorporates referee's comments but changes resulting from the publishing process, such as copyediting, structural formatting, may not be reflected in this document. The published version is available at: [<http://dx.doi.org/10.1007/s11768-016-5125-7>].

*Downloaded on 15 Jul 2024 07:40:50 SGT*

# Distributed Non-Cooperative Robust MPC Based on Reduced-Order Models

Yushen LONG<sup>1†</sup>, Shuai LIU<sup>1</sup>, Lihua XIE<sup>1</sup>, Karl Henrik JOHANSSON<sup>2</sup>

1.School of Electrical and Electronic Engineering, Nanyang Technological University, 639798, Singapore;

2.ACCESS Linnaeus Center, School of Electrical Engineering, Royal Institute of Technology, SE-100 44, Stockholm, Sweden

## Abstract:

In this paper, a non-cooperative distributed MPC algorithm based on reduced order model is proposed to stabilize large-scale systems. The large-scale system consists of a group of interconnected subsystems. Each subsystem can be partitioned into two parts: measurable part, whose states can be directly measured by sensors, and the unmeasurable part. In the online computation phase, only the measurable dynamics of the corresponding subsystem and neighbour-to-neighbour communication are necessary for the local controller design. Satisfaction of the state constraints and the practical stability are guaranteed while the complexity of the optimization problem is reduced. Numerical examples are given to show the effectiveness of this algorithm.

**Keywords:** Model predictive control; Distributed control; Building energy efficiency

DOI

## 1 Introduction

Due to its capability to handle hard constraints on state, control input and output explicitly, and optimize the performance of the system with respect to the cost function [1] [2] [3], model predictive control (MPC) has received increasing attention in the last decades. At each time instant, the controller is required to solve a finite horizon optimal control problem and the first element of the control sequence is applied to the plant. Then the optimization problem is reformulated when a new measurement comes and it is solved again. Traditionally, to compute the optimal control input, the controller needs the full model and state/output information of the system, and the optimization problem is formulated and solved in a centralized manner. However, when interconnected large scale systems such as power systems [4], traffic networks [5], biology systems [6] and building systems [7] are considered, it is usually not practical for the controller to know the full model and state/output information, and solve the optimization prob-

lem in reasonable time. To overcome these obstacles, distributed model predictive control (DMPC) is proposed in a lot of literatures [8] [9] [10] [11].

Usually, in the DMPC setup, the model complexity mainly comes from the large number of interconnected subsystems. In some industrial control applications, each subsystem may also have complex dynamics. For example, the model of heating, ventilation and air-conditioning (HVAC) systems in buildings are usually obtained by discretization of partial differential equations [12] [13]. To guarantee high accuracy, the number of the grids should be large enough and the resulted ordinary differential equations usually have high dimension. Furthermore, because of the limited number of sensors, it is not practical to measure every state of a HVAC system. Therefore, even though the HVAC system in a building can be partitioned into connected subsystems by zones and rooms, the complexity of each subsystem should be reduced further. Model reduction techniques have been proposed in several literatures to simplify system dynamics at the expense of some mod-

<sup>†</sup>Corresponding author.

E-mail: ylong002@e.ntu.edu.sg. Tel.: (+65)9811 3904.

This research is funded by the Republic of Singapore's National Research Foundation through a grant to the Berkeley Education Alliance for Research in Singapore (BEARS) for the Singapore-Berkeley Building Efficiency and Sustainability in the Tropics (SinBerBEST) Program. BEARS has been established by the University of California, Berkeley as a center for intellectual excellence in research and education in Singapore. This research is also supported by National Natural Science Foundation of China (NSFC) under Grants 61573220, 61304045.

elling error [14] [15].

In this paper, we consider a distributed control problem for a large-scale interconnected system where its subsystem also has complex dynamics. Based on the similar idea in [16], the dynamics of each subsystem is assumed to be partitioned to the main dynamics and the minor one. Only the states of the main dynamics are assumed to be measurable. Then for each subsystem, an MPC controller is designed only based on the main dynamics, by which the complexity of the controller is reduced. The modelling errors are handled as disturbances. Then it is shown that this problem can be cast into robust distributed MPC by using an algorithm proposed in [11]. In [11] and [17], the authors studied the distributed algorithms and the implementation issues for large-scale linear systems. Compared with these two works, in this paper, we consider a more complex model and a model reduction technique is introduced to reduced the computational burden.

The remainder of this paper is organized as follows. In Section 2, the problem is formulated. In Section 3 and 4, the design and implementation procedures of the MPC controller are given. In Section 5, a numerical example is given to illustrate our algorithm. Finally, some conclusions are drawn in Section 6.

Some remarks on notations are given as follows.  $\mathbb{R}$  and  $\mathbb{N}$  are used to denote the real number set and the natural number set respectively.  $\mathbf{0}$  denotes a zero matrix with proper dimension. The  $m \times n$  dimensional space is denoted as  $\mathbb{R}^{m \times n}$ . A matrix is Schur stable if its eigenvalues lie in the interior of the unit circle. The Minkowski sum of sets  $A$  and  $B$  is defined as  $C = A \oplus B = \{c = a + b, \forall a \in A \text{ and } b \in B\}$ . The Pontryagin difference of sets  $A$  and  $B$  is defined as  $C = A \ominus B = \{c | c + b \in A, \forall b \in B\}$ . For a discrete-time signal  $s_k$  and  $a, b \in \mathbb{N}, a < b$ , we denote  $s[a : b]$  as  $(s_a, s_{a+1}, \dots, s_b)$ . Given a generic compact set  $\mathbb{X}$ ,  $\mathbb{Y} = \text{box}(\mathbb{X})$  is the smallest hyperrectangle containing  $\mathbb{X}$  with faces perpendicular to the cartesian axis.

## 2 Problem Formulation

Consider a linear discrete-time system

$$\mathbf{x}(k+1) = \mathbf{A}\mathbf{x}(k) + \mathbf{B}\mathbf{u}(k) + \mathbf{D}\mathbf{w}(k), \quad (1)$$

where  $\mathbf{x}(k) \in \mathbb{R}^n$  is the state of the system,  $\mathbf{u}(k) \in \mathbb{R}^m$  is the control input and  $\mathbf{w}(k) \in \mathbb{R}^p$  is the external disturbance.

The system can be partitioned into  $N$  linear, discrete-time, interconnected non-overlapping subsystems. For

each subsystem  $\mathcal{S}_i$ , the system dynamics is given by:

$$\begin{aligned} x_i(k+1) = & A_{i,i}x_i(k) + B_iu_i(k) + \sum_{j \in \mathcal{N}_i^1} A_{i,j}x_j(k) \\ & + D_iw_i(k), \end{aligned} \quad (2)$$

where  $x_i(k) \in \mathbb{R}^{n_i}$ ,  $u_i(k) \in \mathbb{R}^{m_i}$  and  $w_i(k) \in \mathbb{R}^{p_i}$  are the state, the control input and the bounded external disturbance for subsystem  $i$  and  $\mathcal{N}_i^1 = \{j | A_{i,j} \neq \mathbf{0}, j = 1, \dots, N, j \neq i\}$ . According to this decomposition, we have  $\mathbf{x}(k) = (x_1(k), \dots, x_N(k))$ ,  $\mathbf{u}(k) = (u_1(k), \dots, u_N(k))$ ,  $\mathbf{w}(k) = (w_1(k), \dots, w_N(k))$ ,  $\mathbf{A} = \begin{pmatrix} A_{1,1} & \dots & A_{1,N} \\ \vdots & \ddots & \vdots \\ A_{N,1} & \dots & A_{N,N} \end{pmatrix}$ ,  $\mathbf{B} = \text{diag}(B_1, \dots, B_N)$  and  $\mathbf{D} = \text{diag}(D_1, \dots, D_N)$ .

Each  $x_i(k)$  can be further partitioned into two parts: measurable part  $x_i^1(k) \in \mathbb{R}^{n_{1,i}}$  and unmeasurable part  $x_i^2(k) \in \mathbb{R}^{n_{2,i}}$ , where  $n_{1,i} \ll n_{2,i}$ . The matrices  $A_{i,j}$ ,  $B_i$  and  $D_i$  have the corresponding structures:

$$A_{i,j} = \begin{pmatrix} A_{i,j}^{11} & A_{i,j}^{12} \\ A_{i,j}^{21} & A_{i,j}^{22} \end{pmatrix}, B_i = \begin{pmatrix} B_i^1 \\ B_i^2 \end{pmatrix}, D_i = \begin{pmatrix} D_i^1 \\ D_i^2 \end{pmatrix}.$$

The initial value of  $x_i^2(k)$  is bounded by a known polyhedron  $\Delta_i$ . The external disturbance  $w_i(k)$  is bounded by  $\mathbb{W}_i$ . The matrix  $A_{i,i}^{22}$  is Schur. The objective of this paper is to design a distributed control law to stabilize the system while enforcing the local constraints  $x_i^1(k) \in \mathbb{X}_i$ ,  $u_i(k) \in \mathbb{U}_i$  and the joint constraints  $(x_1^1(k), \dots, x_N^1(k), u_1(k), \dots, u_N(k)) \in \mathbb{J}_l$ ,  $l = 1, \dots, n_c$ . The sets  $\mathbb{W}_i$ ,  $\mathbb{X}_i$ ,  $\mathbb{U}_i$  and  $\mathbb{J}_l$  are polyhedron containing the origin in their interiors. If the projection of the polyhedron  $\mathbb{J}_l$  on  $(x_i^1, u_i)$  is not the whole hyperplane,  $(x_i^1, u_i)$  is called an argument of  $\mathbb{J}_l$ . If  $(x_i^1, u_i)$  and  $(x_j^1, u_j)$  are arguments of  $\mathbb{J}_l$ ,  $\mathbb{J}_l$  is defined as a joint constraint on subsystem  $i$  and  $j$ . We call subsystem  $j$  a neighbor of subsystem  $i$  if  $A_{i,j} \neq \mathbf{0}$  and/or they have at least one common joint constraint  $h_m$ . We do not consider constraint on  $x_i^2(k)$ .

## 3 Controller Design

For simplicity, in this section, we assume that  $D_i^2$ ,  $A_{i,j}^{12}$  and  $A_{i,j}^{22}$  are  $\mathbf{0}$ ,  $\forall i \neq j$ .

### 3.1 Bounded Unmeasurable State

First we rewrite the dynamics of  $x_i^2(k)$  into the following form:

$$\begin{aligned} x_i^2(k+1) &= A_{i,i}^{22}x_i^2(k) + d_i^2(k), \\ d_i^2(k) &= A_{i,i}^{21}x_i^1(k) + B_1^2u_i(k) + \sum_{j \in \mathcal{N}_i^1} A_{i,j}^{21}x_j^1(k). \end{aligned}$$

Thus we obtain

$$x_i^2(k) = (A_{i,i}^{22})^k x_i^2(0) + \sum_{l=0}^{k-1} (A_{i,i}^{22})^{k-1-l} d_i^2(l). \quad (3)$$

Considering the bounds on  $x_i(k)$ ,  $x_j(k)$  and  $u_i(k)$ , we know that  $d_i^2(k) \in A_{i,i}^{21}\mathbb{X}_i \oplus B_1^2\mathbb{U}_i \oplus \sum_{j \in \mathcal{N}_i^1} A_{i,j}^{21}\mathbb{X}_j \triangleq \mathbb{D}_i^2$ . Therefore by (3), we have  $x_i^2(k) \in (A_{i,i}^{22})^k \Delta_i \oplus \sum_{l=0}^{k-1} (A_{i,i}^{22})^l \mathbb{D}_i^2 \triangleq \mathbb{S}_i^2(\infty)$ . An over-approximation  $\mathbb{S}_i^2(\infty)$  for all  $\mathbb{S}_i^2(k)$ ,  $k \in \mathbb{N}$  can be easily given by  $\Delta_i \oplus (I - A_{i,i}^{22})^{-1} \mathbb{D}_i^2$ .

Rewrite the dynamics of  $x_i^1(k)$  in the following form:

$$\begin{aligned} x_i^1(k+1) &= A_{i,i}^{11}x_i^1(k) + B_i^1u_i(k) + \sum_{j \in \mathcal{N}_i^1} A_{i,j}^{11}x_j^1(k) \\ &\quad + d_i^1(k), \\ d_i^1(k) &= A_{i,i}^{12}x_i^2(k) + D_i^1w_i(k). \end{aligned} \quad (4)$$

From the above discussion, we know that  $d_i^1(k) \in \mathbb{S}_i^2(\infty) \oplus D_i^1\mathbb{W}_i \triangleq \mathbb{D}_i^1$ . This fact implies that  $d_i^1(k)$  can be treated as an additive bounded disturbance to  $x_i^1(k)$ . Therefore distributed robust MPC can be designed to stabilize this system.

### 3.2 Distributed Robust MPC

Consider the nominal subsystem model

$$\hat{x}_i(k+1) = A_{i,i}^{11}\hat{x}_i(k) + B_i^1\hat{u}_i(k) + \sum_{j \in \mathcal{N}_i^1} A_{i,j}^{11}\tilde{x}_j(k), \quad (5)$$

where  $\hat{x}_i(k)$  is the nominal state trajectory,  $\hat{u}_i(k)$  is the nominal control input and  $\tilde{x}_i(k)$  is the reference state trajectory which will all be specified later.

Before providing the distributed robust MPC algorithm, the following assumption on decentralized stabilizability is necessary.

**Assumption 1** There exist matrices  $K_i$ ,  $i = 1, \dots, N$  such that (i)  $A_{K_i} = A_{i,i}^{11} + B_i^1K_i$  is Schur, (ii)  $\hat{\mathbf{A}} +$

$$\hat{\mathbf{B}}\mathbf{K} \text{ is Schur, where } \hat{\mathbf{A}} = \begin{pmatrix} A_{1,1}^{11} & \dots & A_{1,N}^{11} \\ \vdots & \ddots & \vdots \\ A_{N,1}^{11} & \dots & A_{N,N}^{11} \end{pmatrix}, \hat{\mathbf{B}} =$$

$\text{diag}(B_1^1, \dots, B_N^1)$  and  $\mathbf{K} = \text{diag}(K_1, \dots, K_N)$ .

The control law for the  $i$ -th subsystem (2) is given by

$$u_i(k) = \hat{u}_i(k) + K_i(x_i^1(k) - \hat{x}_i(k)). \quad (6)$$

By defining  $e_i(k) = x_i^1(k) - \hat{x}_i(k)$ , (4), from (5) and (6), we have

$$\begin{aligned} e_i(k+1) &= A_{K_i}e_i(k) + \sum_{j \in \mathcal{N}_i^1} A_{i,j}^{11}(x_j^1(k) - \tilde{x}_j(k)) \\ &\quad + d_i^1(k) \end{aligned} \quad (7)$$

Due to the stability of the matrix  $A_{K_i}$  and the boundedness of  $d_i(k)$ , if it can be further guaranteed that  $x_j^1(k) - \tilde{x}_j(k)$  are bounded,  $\forall j = 1, \dots, N$ , there exists a robust positively invariant set  $\mathbb{E}_i$  for (7), such that  $\forall e_i(k) \in \mathbb{E}_i$ ,  $e_i(k+1) \in \mathbb{E}_i$  which implies that if  $\hat{x}_i(k) \rightarrow 0$  as  $k \rightarrow \infty$ ,  $x_i^1(k) \rightarrow \mathbb{E}_i$  as  $k \rightarrow \infty$ .

At each time instant  $t$ , each subsystem  $\mathcal{S}_i$  transmits its future state and control reference trajectory over the prediction horizon  $N_c$  to its neighbors  $\mathcal{N}_i^1$ , and the MPC controller of each subsystem  $\mathcal{S}_i$  solves the following  $i$ -th optimization problem:

$$\min_{\hat{x}_i(t), \hat{u}_i[t:t+N_c-1]} V_i^N$$

subject to (5),

$$x_i^1(t) - \hat{x}_i(t) \in \mathbb{E}_i, \quad (8)$$

and for  $k = t, \dots, t + N_c - 1$  and  $l = 1, \dots, n_c$ ,

$$\hat{x}_i(k) - \tilde{x}_i(k) \in \mathbb{Z}_i, \quad (9)$$

$$\hat{u}_i(k) - \tilde{u}_i(k) \in \mathbb{S}_i, \quad (10)$$

$$\hat{x}_i(k) \in \hat{\mathbb{X}}_i \subseteq \mathbb{X}_i \ominus \mathbb{E}_i,$$

$$\hat{u}_i(k) \in \hat{\mathbb{U}}_i \subseteq \mathbb{U}_i \ominus K_i\mathbb{E}_i,$$

$$(\hat{x}_i^1(k), \hat{u}_i(k), \tilde{x}_{-i}^1(k), \tilde{u}_{-i}(k)) \in \hat{\mathbb{J}}_l$$

$$\hat{x}_i(t + N_c) \in \hat{\mathbb{X}}_i^F,$$

where  $V_i^N = \sum_{k=t}^{t+N_c-1} l_i(\hat{x}_i(k), \hat{u}_i(k)) + V_i^F(\hat{x}_i(t + N_c))$ ,  $\mathbb{Z}_i$  is a convex set which contains the origin as its interior point,  $\hat{\mathbb{X}}_i^F$  is a nominal terminal set,  $l_i(\hat{x}_i(k), \hat{u}_i(k)) = \hat{x}_i(k)^T P_i \hat{x}_i(k) + \hat{u}_i(k)^T Q_i \hat{u}_i(k)$  is the stage cost,  $V_i^F(\hat{x}_i(t + N_c)) = \hat{x}_i(t + N_c)^T R_i \hat{x}_i(t + N_c)$  is the terminal cost,  $\hat{\mathbb{J}}_l$  is constructed such that if  $(\hat{x}_i^1(k), \hat{u}_i(k), \tilde{x}_{-i}^1(k), \tilde{u}_{-i}(k)) \in \hat{\mathbb{J}}_l$  then  $(x_1^1(k), \dots, x_N^1(k), u_1(k), \dots, u_N(k)) \in \mathbb{J}_l$  with  $\tilde{x}_{-i}^1(k) = (\tilde{x}_1^1(k), \dots, \tilde{x}_{i-1}^1(k), \tilde{x}_{i+1}^1(k), \dots, \tilde{x}_N^1(k))$  and  $\tilde{u}_{-i}^1(k) = (\tilde{u}_1^1(k), \dots, \tilde{u}_{i-1}^1(k), \tilde{u}_{i+1}^1(k), \dots, \tilde{u}_N^1(k))$

**Remark 1** (8) implies that  $e_i(t) \in \mathbb{E}_i$ . Based on the invariance of  $\mathbb{E}_i$  and by induction, it follows that  $e_i(k) \in \mathbb{E}_i$ ,  $k = t, \dots, t + N_c - 1$ . Combining this fact with

constraint (10), it can be obtained that  $x_i^1(k) - \tilde{x}_i(k) \in \mathbb{E}_i \oplus \mathbb{Z}_i$ ,  $k = t, \dots, t + N_c - 1$  which guarantees the boundedness of  $\sum_{j \in \mathcal{N}_i^1} A_{i,j}^{11}(x_j^1(k) - \tilde{x}_j(k)) + d_i^1(k)$  in (7). Considering (7), a sufficient condition of the sets  $\mathbb{E}_i$  and  $\mathbb{Z}_i$ ,  $i = 1, \dots, N$  is that

$$A_{K_i} \mathbb{E}_i \oplus \sum_{j \in \mathcal{N}_i^1} A_{i,j}^{11}(\mathbb{E}_j \oplus \mathbb{Z}_j) \oplus \mathbb{D}_i^1 \subseteq \mathbb{E}_i. \quad (11)$$

The following assumptions for the terminal constraint  $\hat{\mathbb{X}}_i^F$  and terminal cost function  $V_i^F(\cdot)$  are necessary to guarantee the recursive feasibility of the optimization problem and stability of the system.

**Assumption 2** Denote  $\hat{\mathbb{X}} = \prod_{i=1}^N \hat{\mathbb{X}}_i$ ,  $\hat{\mathbb{U}} = \prod_{i=1}^N \hat{\mathbb{U}}_i$ ,  $\hat{\mathbb{X}}^F = \prod_{i=1}^N \hat{\mathbb{X}}_i^F$  and  $\hat{\mathbf{x}} = (\hat{x}_1, \dots, \hat{x}_N)$ .

- i)  $\hat{\mathbb{X}}^F \subseteq \hat{\mathbb{X}}$  is an invariant set for  $\hat{\mathbf{x}}(k+1) = (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K})\hat{\mathbf{x}}(k)$ ;
- ii)  $\mathbf{K}\hat{\mathbf{x}}(k) \in \hat{\mathbb{U}}$  for all  $\hat{\mathbf{x}}(k) \in \hat{\mathbb{X}}^F$ ;
- iii) for all  $\hat{\mathbf{x}}(k) \in \hat{\mathbb{X}}^F$  and for a given constant  $\alpha > 0$ ,

$$\begin{aligned} & \sum_{i=1}^N [V_i^F(\hat{x}_i(k+1)) - V_i^F(\hat{x}_i(k))] \\ & \leq -(1 + \alpha) \sum_{i=1}^N l_i(\hat{x}_i(k), \hat{u}_i(k)). \end{aligned}$$

At each time instant  $t$ , a pair  $(\hat{x}_i(t), \hat{u}_i[t : t + N_c - 1])$  can be obtained by  $S_i$  by solving the  $i$ -th problem. Based on (5) and (6), the future state trajectory  $\hat{x}_i[t+1 : t + N_c]$  can also be computed. Then set  $\tilde{x}_i(t + N_c) = \hat{x}_i(t + N_c)$  and  $\tilde{u}_i(t + N_c) = \hat{u}_i(t + N_c)$  as the last elements of the reference state and control trajectory and transmitted to the neighbours of the  $i$ -th subsystem for updating and reformulating the local optimization problems at time instant  $t+1$ .

Based on the above setup, we have the following convergence result of the distributed MPC algorithm.

**Theorem 1** If Assumption 1 and 2 hold, then  $(x_1^1(k), \dots, x_N^1(k))$  exponentially converges to the invariant set of system  $\mathbf{x}(k+1) = (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K})\mathbf{x}(k) + \mathbf{d}(k)$ , where  $\mathbf{d}(k) = (d_1^1(k), \dots, d_N^1(k))$ .

The proof goes along the line of Theorem 1 in [11] so it is omitted here.

## 4 Implementation

In this section, some algorithms for the computation of the weighted matrices, the feedback gains, the invariant sets and the initial feasible reference trajectory will be briefly introduced [17].

### 4.1 Feedback Gains and Weighted Matrices

Denote  $\mathbf{R} = \text{diag}(R_1, \dots, R_N)$ . Define matrices  $\mathbf{S} = \mathbf{R}^{-1}$  and  $\mathbf{Y} = \mathbf{K}\mathbf{S}$ . Considering  $\mathbf{S}$  and  $\mathbf{Y}$  as feasible solutions to the following LMI, the feedback gain  $K_i$  and terminal weighted matrices  $R_i$  which satisfy Assumption 1 with  $\mathbf{R} - (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K})^T \mathbf{R} (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K}) \succ 0$  can be obtained by the definition of  $\mathbf{S}$  and  $\mathbf{Y}$ .

$$\begin{pmatrix} \mathbf{S} & (\hat{\mathbf{A}}\mathbf{S} + \hat{\mathbf{B}}\mathbf{Y})^T \\ \hat{\mathbf{A}}\mathbf{S} + \hat{\mathbf{B}}\mathbf{Y} & \mathbf{S} \end{pmatrix} \succ 0, \quad (12)$$

$$\begin{pmatrix} \mathbf{S}_{i,i} & (\hat{\mathbf{A}}_{i,i}\mathbf{S}_{i,i} + \hat{\mathbf{B}}_{i,i}\mathbf{Y}_{i,i})^T \\ \hat{\mathbf{A}}_{i,i}\mathbf{S}_{i,i} + \hat{\mathbf{B}}_{i,i}\mathbf{Y}_{i,i} & \mathbf{S}_{i,i} \end{pmatrix} \succ 0, \quad (13)$$

$$\mathbf{S}_{i,j} = \mathbf{0}, \forall i, j = 1, \dots, N (i \neq j), \quad (14)$$

$$\mathbf{Y}_{i,j} = \mathbf{0}, \forall i, j = 1, \dots, N (i \neq j), \quad (15)$$

where  $\mathbf{S}_{i,j}$  and  $\mathbf{Y}_{i,j}$ ,  $\forall i, j = 1, \dots, N$  are the  $(i, j)$ th block of  $\mathbf{S}$  and  $\mathbf{Y}$ .

Once  $\mathbf{K}$  and  $\mathbf{R}$  are computed,  $\mathbf{P} = \text{diag}(P_1, \dots, P_N)$  and  $\mathbf{Q} = \text{diag}(Q_1, \dots, Q_N)$  can be constructed to satisfy Assumption 2 iii) by considering the following inequality:

$$\mathbf{R} - (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K})^T \mathbf{R} (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K}) - (\mathbf{Q} + \mathbf{K}^T \mathbf{P} \mathbf{K})(1 + \alpha) \succ 0$$

Due to the positiveness of  $\mathbf{R} - (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K})^T \mathbf{R} (\hat{\mathbf{A}} + \hat{\mathbf{B}}\mathbf{K})$ , the above inequality can be satisfied by choosing sufficiently small  $\alpha$ ,  $\mathbf{P}$  and  $\mathbf{Q}$ .

### 4.2 Computation of Sets

Sets  $\mathbb{D}_i^1$ ,  $i = 1, \dots, N$  can be easily computed following the discussion in Section 3. Then it needs to find  $\mathbb{Z}_i \neq \emptyset$ ,  $\mathbb{E}_i \subset \mathbb{X}_i$  and  $K_i \mathbb{E}_i \subset \mathbb{U}_i$  which satisfy (11) for all  $i = 1, \dots, N$ . By using the  $\text{box}(\cdot)$  operator, sets  $\mathbb{E}_i$  and  $\mathbb{Z}_i$ ,  $i = 1, \dots, N$  can be constructed by the following algorithm.

#### Algorithm 1

- Step 1: initialize  $\mathbb{Z}_i$ ,  $i = 1, \dots, N$  as arbitrarily hyper-rectangles.
- Step 2: initialize  $\mathbb{E}_i = \sum_{j \in \mathcal{N}_i^1} \text{box}(A_{i,j}^{11} \mathbb{Z}_j) \oplus \text{box}(\mathbb{D}_i^1)$ ,  $i = 1, \dots, N$ .
- Step 3: compute  $\mathbb{E}_i^+ = \text{box}(A_{K_i} \mathbb{E}_i) \oplus \sum_{j \in \mathcal{N}_i^1} \text{box}(A_{i,j}^{11}(\mathbb{E}_j \oplus \mathbb{Z}_j)) \oplus \text{box}(\mathbb{D}_i^1)$ ,  $i = 1, \dots, N$ .
- Step 4: for all  $i = 1, \dots, N$ , if  $\mathbb{E}_i^+ \subset \mathbb{E}_i$ , which means that  $\mathbb{E}_i$  satisfies (11), then go to step 5. Otherwise set  $\mathbb{E}_i = \mathbb{E}_i^+$  and repeat step 3.
- Step 5: if  $\mathbb{E}_i \subset \mathbb{X}_i$  and  $K_i \mathbb{E}_i \subset \mathbb{U}_i$  then stop. Otherwise set  $\mathbb{Z}_i = \beta \mathbb{Z}_i$  with  $\beta \in (0, 1)$  and go to step 2.

Finally,  $\hat{\mathbb{X}}_i^F$  can be simply chosen as  $\beta \mathbb{E}_i$  with  $\beta \in (0, 1)$ .

### 4.3 Initial Feasible Reference Trajectories

Denote the current measurement of system state is  $\tilde{\mathbf{x}}(0) = (\tilde{x}_1(0), \dots, \tilde{x}_N(0))$ . The algorithm to find the initial feasible reference trajectories of each subsystem  $\mathcal{S}_i$  is based on the one-step prediction.

#### Algorithm 2

- Step 1: for all  $i = 1, \dots, N$ , initialize  $\tilde{x}_i(0)$  and  $v = 0$ .
- Step 2: for all  $i = 1, \dots, N$ , each subsystem  $\mathcal{S}_i$  transmits its state  $\hat{x}_i(v)$  to its neighbours  $\mathcal{S}_j$ ,  $j \in \mathcal{N}_i^1$  and solves the following optimization problem.

$$\min_{\hat{u}_i(v)} \|\tilde{x}_i(v+1)\|^2$$

subject to

$$\tilde{x}_i(v+1) = A_{i,i}^1 \tilde{x}_i(v) + B_i^1 \hat{u}_i(v) + \sum_{j \in \mathcal{N}_i^1} A_{i,j}^1 \tilde{x}_j(v)$$

$$\tilde{x}_i(v+1) \in \hat{\mathbb{X}}_i$$

$$(\hat{x}_i^1(k), \hat{u}_i(k), \tilde{x}_{-i}^1(k), \tilde{u}_{-i}(k)) \in \hat{\mathbb{J}}_i$$

$$\hat{u}_i(v) \in \hat{\mathbb{U}}_i$$

- Step 3: for  $i = 1, \dots, N$ , if  $\tilde{x}_i(v+1) \in \hat{\mathbb{X}}_i^F$ , set prediction horizon as  $v+1$  and stop. Otherwise, set  $v = v+1$  and go to step 2.

## 5 Numerical Example

In this section, the proposed control algorithm is tested on a building temperature regulation problem proposed in [17] with slightly modification.

Consider four connected rooms  $A, B, C$  and  $D$  as in Fig. 1. Room  $A$  and  $B$  are combined together as one apartment while room  $C$  and  $D$  as the other apartment. The air temperature  $T_A, T_B, T_C$  and  $T_D$  are considered as the measurable states and the control objective is to regulate them to the set point. Each room is equipped with an air-conditioner  $q_A, q_B, q_C$  and  $q_D$ . The heat transfer coefficient between rooms  $A - C$  and  $B - D$  is  $k_1^t = 5.8\text{W/m}^2\text{K}$ , the one between rooms  $A - B$  and  $C - D$  is  $k_2^t = 5.8\text{W/m}^2\text{K}$ , and the one between each room and the external environment is  $k_e^t = 3\text{W/m}^2\text{K}$ . The nominal external temperature  $\bar{T}_E$  is  $35^\circ\text{C}$  and solar radiation is not considered for simplicity. The volume of each room is  $V = 48\text{m}^3$ , and the wall surfaces between the rooms are all equal to  $s_r = 12\text{m}^2$ , while those between the rooms and the environment are equal to  $s_e = 24\text{m}^2$ . Air density and heat capacity are  $\rho = 1.225\text{kg/m}^3$  and  $c = 1005\text{J/kgK}$ , respectively. Letting  $\phi = \rho cV$ , the dynamic model is the

following:

$$\begin{aligned} \phi \frac{dT_A}{dt} &= s_r k_2^t (T_B - T_A) + s_r k_1^t (T_C - T_A) \\ &\quad + s_e k_e^t (T_E - T_A) + \sum_{i=1}^3 s_A^i k_A^i (T_A^i - T_A) - q_A \end{aligned}$$

$$\begin{aligned} \phi \frac{dT_B}{dt} &= s_r k_2^t (T_A - T_B) + s_r k_1^t (T_D - T_B) \\ &\quad + s_e k_e^t (T_E - T_B) + \sum_{i=1}^3 s_B^i k_B^i (T_B^i - T_B) - q_B \end{aligned}$$

$$\begin{aligned} \phi \frac{dT_C}{dt} &= s_r k_2^t (T_A - T_C) + s_r k_1^t (T_D - T_C) \\ &\quad + s_e k_e^t (T_E - T_C) + \sum_{i=1}^3 s_C^i k_C^i (T_C^i - T_C) - q_C \end{aligned}$$

$$\begin{aligned} \phi \frac{dT_D}{dt} &= s_r k_2^t (T_B - T_D) + s_r k_1^t (T_C - T_D) \\ &\quad + s_e k_e^t (T_E - T_D) + \sum_{i=1}^3 s_D^i k_D^i (T_D^i - T_D) - q_D \end{aligned}$$

$$\phi \frac{dT_A^i}{dt} = 60 s_A^i k_A^i (T_A - T_A^i), \quad i = 1, 2, 3$$

$$\phi \frac{dT_B^i}{dt} = 60 s_B^i k_B^i (T_B - T_B^i), \quad i = 1, 2, 3$$

$$\phi \frac{dT_C^i}{dt} = 60 s_C^i k_C^i (T_C - T_C^i), \quad i = 1, 2, 3$$

$$\phi \frac{dT_D^i}{dt} = 60 s_D^i k_D^i (T_D - T_D^i), \quad i = 1, 2, 3$$

where  $T_A^i, T_B^i, T_C^i$  and  $T_D^i$ ,  $i = 1, 2, 3$  are used to represent the thermal dynamics of furniture and walls which are assumed unmeasurable,  $s_A^i, s_B^i, s_C^i$  and  $s_D^i$  are the equivalent surfaces chosen randomly, and  $k_A^i, k_B^i, k_C^i$  and  $k_D^i$  are the equivalent heat transfer coefficients chosen randomly.

The considered equilibrium point is:  $q_A = q_B = q_C = q_D = \bar{q} = s_e k_e^t (\bar{T} - \bar{T}_E) = 1081.4\text{W}$ , with  $T_A = T_B = T_C = T_D = \bar{T} = 20^\circ\text{C}$ . Let  $\delta T_A = T_A - \bar{T}$ ,  $\delta T_B = T_B - \bar{T}$ ,  $\delta T_C = T_C - \bar{T}$ ,  $\delta T_D = T_D - \bar{T}$ ,  $\delta q_A = (q_A - \bar{q})/c\rho V$ ,  $\delta q_B = (q_B - \bar{q})/c\rho V$ ,  $\delta q_C = (q_C - \bar{q})/c\rho V$  and  $\delta q_D = (q_D - \bar{q})/c\rho V$ .

The corresponding discrete-time model of the form (1) is obtained by mE-ZOH discretization [18] with sampling time  $h = 10\text{s}$ . The partition of inputs and measurable states is:

$$\begin{aligned} x^1 &= [\delta T_A \ \delta T_B]^T, \quad u^1 = [\delta q_A \ \delta q_B]^T \\ x^2 &= [\delta T_C \ \delta T_D]^T, \quad u^2 = [\delta q_C \ \delta q_D]^T \end{aligned}$$

The constraints on the inputs and the states of the discretized system is:

$$x_{\min}^1 = [-10 \ -10]^T, \quad x_{\max}^1 = [10 \ 10]^T$$

$$\begin{aligned} x_{\min}^2 &= [-10 \ -10]^T, \ x_{\max}^2 = [10 \ 10]^T \\ u_{\min}^1 &= [-2500 \ -2500], \ u_{\max}^1 = [2500 \ 2500] \\ u_{\min}^2 &= [-2500 \ -2500], \ u_{\max}^2 = [2500 \ 2500] \\ \|u^1\|_1 + \|u^2\|_1 &\leq 8000 \end{aligned}$$

Matrices  $K_i = \begin{pmatrix} -0.0193 & -0.0002 \\ -0.0002 & -0.0193 \end{pmatrix}$  and  $R_i = \begin{pmatrix} 2.9249 \cdot 10^7 & 118.2915 \\ 118.2915 & 2.9249 \cdot 10^7 \end{pmatrix}$  are constructed by finding feasible solutions to LMI (12)-(15). The selected weighting matrices are  $P_i = I_2$  and  $Q_i = 100I_2$ . Algorithm 1 is used to find the invariant sets and the initial feasible reference trajectory is constructed by using Algorithm 2 with  $N_c = 6$ .

The initial condition of this numerical example is  $\delta T_A = 3^\circ C$ ,  $\delta T_B = 2^\circ C$ ,  $\delta T_C = 4^\circ C$  and  $\delta T_D = 5^\circ C$ . The initial temperature of the unmeasurable states are randomly chosen between  $[22^\circ C, 25^\circ C]$ . The real external temperature is assumed to randomly vary between  $[25^\circ C, 45^\circ C]$ . At time instant  $t = 700s$ , there is a sudden increase of temperature  $T_A$  and  $T_B$  representing the opening of doors and windows. Over time interval  $[700s, 1400s]$  additional heat sources with  $30^\circ C$  are added in both rooms. The control input is calculated by using the descretized model and applied to the continuous-time model. The simulation results are shown in Fig. 2. To compare the performance of the proposed distributed algorithm, a decentralized MPC and a centralized MPC with complete state information are also used to regulate the temperature. The simulation results are shown in Fig. 3-4. To show the difference among these algorithms more clearly, the temperature deviation between distributed algorithm and the decentralized algorithm are shown in Fig. 5-6. The temperature deviation between distributed algorithm and the centralized algorithm are shown in Fig. 7-8.

In the Fig. 2-4, the black dashed lines represent the corresponding main states and control inputs of room A and C while the grey solid lines represent those of room C and D. in Fig. 5 the black dashed line represents  $\delta T_{A,dis} - \delta T_{A,dec}$  and the grey solid line represents  $\delta T_{B,dis} - \delta T_{B,dec}$ , and in Fig. 6 they represent  $\delta T_{C,dis} - \delta T_{C,dec}$  and  $\delta T_{D,dis} - \delta T_{D,dec}$  respectively. In Fig. 7 the black dashed line represents  $\delta T_{A,dis} - \delta T_{A,c}$  and the grey solid line represents  $\delta T_{B,dis} - \delta T_{B,c}$ , and in Fig. 8 they represent  $\delta T_{C,dis} - \delta T_{C,c}$  and  $\delta T_{D,dis} - \delta T_{D,c}$  respectively. The subscripts *dis*, *dec*, *c* represent distributed algorithm, decentralized algorithm and centralized algorithm respectively. For clarity reason, the minor dynamics are not shown in these fig-

ures.

In the decentralized algorithm, there is no information exchange between controllers. Therefore the joint constraint  $\|u^1\|_1 + \|u^2\|_1 \leq 8000$  is tightened as  $\|u^1\|_1 \leq 4000$  and  $\|u^2\|_1 \leq 4000$ . The dynamics coupling terms are treated as unknown bounded disturbance and the method in [19] are used to design local controller. For the centralized algorithm, we also follow the way in [19] to design the centralized controller.

From Figs. 2-4 it can be observed that with the additional heat source, all the three algorithms have some off-set. From Fig 5-6 one can see that distributed algorithm has faster response than the decentralized one. This is due to the fact that in the distributed algorithm, controllers can communicate with each other. Therefore, controllers for room A and B know how much power will be used by the other two controllers and the overall power, which is restricted to be less or equal to  $8000W$ , can be used more efficiently. This fact can also be observed in Fig. 2-3. In Fig. 2, controllers for room A and B attain the maximal power  $2500W$  while in Fig. 3, their power has to satisfy the constraint  $q_A + q_B \leq 4000W$ . The off-set of both algorithms are similar. Fig 7-8 show that centralized algorithm has faster response than the distributed one and its off-set is also smaller than that of the distributed one. This is not surprising because the centralized algorithm utilizes the complete state information.

Finally, we compare the energy, which is defined as  $\int_0^{2110} \sum_{A,B,C,D} \|q_i\| dt$ , and the average computational time consumed by the three algorithms in Table 1.

Table 1 Cost and average computational time of the three algorithms

	time(s)	cost(kJ)
Centralized (full model)	0.47	732
Distributed (reduced order)	0.23	758
Decentralized (reduced order)	0.35	893

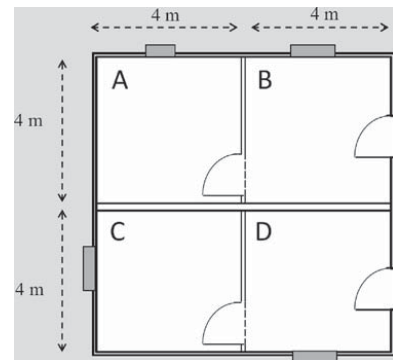


Fig. 1 Schematic representation of a building with two apartments

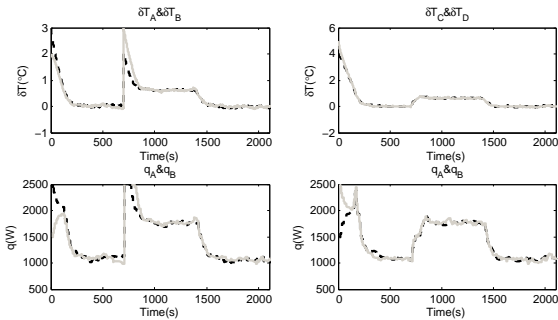


Fig. 2 State and input trajectory of distributed algorithm

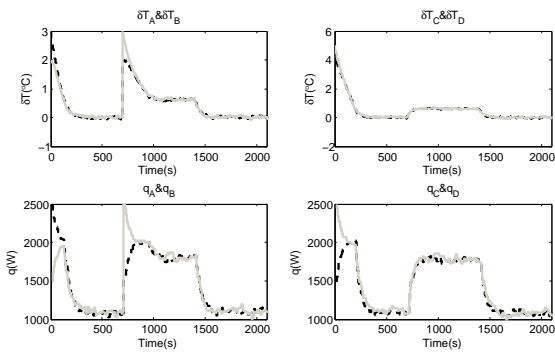


Fig. 3 State and input trajectory of decentralized algorithm

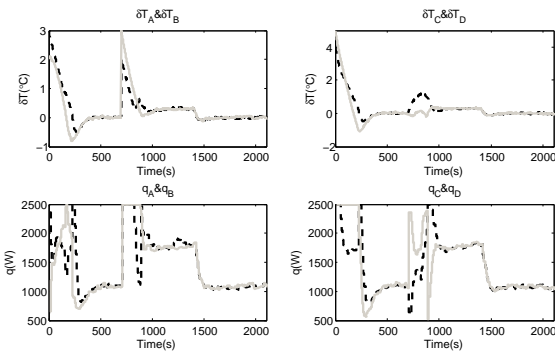


Fig. 4 State and input trajectory of centralized full order algorithm

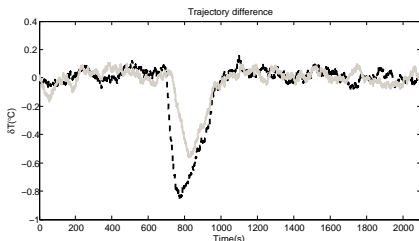


Fig. 5 Temperature deviation between distributed and decentralized algorithm (room A and B). In this example, the air-conditioning system is working on cooling mode. Therefore the distributed algorithm has faster response than the decentralized one since the former one has lower temperature.

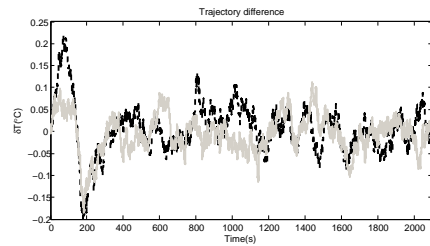


Fig. 6 Temperature deviation between distributed and decentralized algorithm (room C and D)

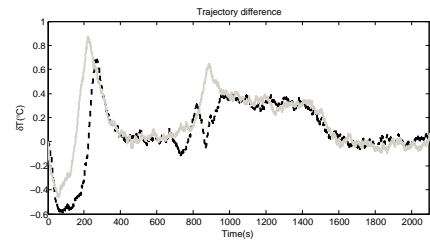


Fig. 7 Temperature deviation between distributed and centralized algorithm (room A and B)

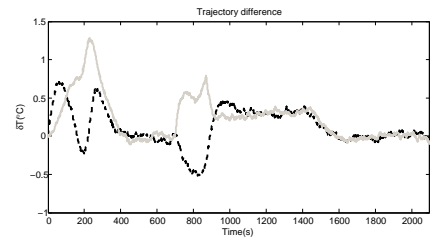


Fig. 8 Temperature deviation between distributed and centralized algorithm (room C and D)

## 6 Conclusion

In this paper, a distributed robust MPC algorithm has been proposed. Each subsystem can be partitioned into measurable main dynamics and unmeasurable minor dynamics. Only the main dynamics is used to predict the future trajectory while the minor dynamics is not handled explicitly in the online computation, by which the complexity of the optimization problem is significantly reduced. Numerical examples has been given to illustrate the effectiveness of our algorithm.

## References

- [1] D. Q. Mayne, J. B. Rawlings, C. V. Rao, and P. O. M. Scaekaert. Constrained model predictive control: Stability and optimality. *Automatica*, 2000, 36(6): 789 – 814.
- [2] J. B. Rawlings. Tutorial overview of model predictive control. *IEEE Control Systems*, 2000, 20(3): 38 – 52.
- [3] S. Qin and T. Badgwell. A survey of industrial model predictive control technology. *Control Engineering Practice*, 2003, 11(7): 733



– 764.

- [4] P. Cortes, M. P. Kazmierkowski, R. M. Kennel, D. E. Quevedo, and J. Rodriguez. Predictive control in power electronics and drives. *IEEE Transactions on Industrial Electronics*, 2008, 55(12): 4312 – 4324.
- [5] T. Tettamanti, I. Varga, B. Kulcsar, and J. Bokor. Model predictive control in urban traffic network management. *Mediterranean Conference on Control and Automation*, New York: IEEE, 2008: 1538 – 1543.
- [6] R. Hovorka, V. Canonico, L. J. Chassin, U. Haueter, M. Massi-Benedetti, M. O. Federici, T. R. Pieber, H. C. Schaller, L. Schaupp, and T. Vering. Nonlinear model predictive control of glucose concentration in subjects with type 1 diabetes. *Physiological Measurement*, 2004, 25(4): 905 – 920.
- [7] Y. Ma, G. Anderson, and F. Borrelli. A distributed predictive control approach to building temperature regulation. *American Control Conference*, New York: IEEE, 2011: 2089 – 2094.
- [8] A. Venkat, J. Rawlings, and S. Wright. Stability and optimality of distributed model predictive control. *IEEE Conference on Decision and Control and European Control Conference*, New York: IEEE, 2005: 6680 – 6685.
- [9] W. B. Dunbar. Distributed receding horizon control of dynamically coupled nonlinear systems. *IEEE Transactions on Automatic Control*, 2007, 52(7): 1249 – 1263.
- [10] J. Liu, X. Chen, D. Muoz de la Pea, and P. D. Christofides. Sequential and iterative architectures for distributed model predictive control of nonlinear process systems. *AIChE Journal*, 2010, 56(8): 2137 – 2149.
- [11] M. Farina and R. Scattolini. Distributed predictive control: A non-cooperative algorithm with neighbor-to-neighbor communication for linear systems. *Automatica*, 2012, 48(6): 1088 – 1096.
- [12] T. Kim, S. Kato, and S. Murakami. Indoor cooling/heating load analysis based on coupled simulation of convection, radiation and hvac control. *Building and Environment*, 2001, 36(7): 901 – 908.
- [13] F. Moukalled, S. Verma, and M. Darwish. The use of cfd for predicting and optimizing the performance of air conditioning equipment. *International Journal of Heat and Mass Transfer*, 2011, 54(13): 549 – 563.
- [14] S. Goyal and P. Barooah. A method for model-reduction of nonlinear thermal dynamics of multi-zone buildings. *Energy and Buildings*, 2012, 47: 332 – 340.
- [15] K. Deng, S. Goyal, P. Barooah, and P. G. Mehta. Structure-preserving model reduction of nonlinear building thermal models. *Automatica*, 2014, 50(4): 1188 – 1195.
- [16] P. Sopasakis, D. Bernardini, and A. Bemporad. Constrained model predictive control based on reduced-order models. *IEEE Conference on Decision and Control*, New York: IEEE, 2013: 7071 – 7076.
- [17] G. Betti, M. Farina, and R. Scattolini. Realization issues, tuning, and testing of a distributed predictive control algorithm. *Journal of Process Control*, 2014, 24(4): 424 – 434.
- [18] M. Farina, P. Colaneri, and R. Scattolini. Block-wise discretization accounting for structural constraints. *Automatica*, 2013, 49(11): 3411 – 3417.
- [19] D. Q. Mayne, M. M. Seron, and S. V. Rakovi. Robust model predictive control of constrained linear systems with bounded disturbances. *Automatica*, 2005, 41(2): 219 – 224.

**Yushen LONG** received the B.Sc. degree in Control Engineering from Tianjin University, China, in 2012. Currently he is pursuing his Ph.D. degree of Control Engineering at Nanyang Technological University. His research interests are multi-agent systems, model predictive control, and building systems. E-mail: ylong002@e.ntu.edu.sg.

**Shuai LIU** received his B.E. and M.E. degrees in Control Theory and Engineering from Shandong University in 2004 and 2007, respectively, and his Ph.D. degree in Electrical and Electronic Engineering from Nanyang Technological University, Singapore, in 2012. Since 2011, he has been a research fellow with Berkeley education alliance for research in Singapore (BEARS). His research interests include cooperative control, distributed consensus, optimal estimation and control, time-delay systems, fault detection and estimation. E-mail: lius0025@e.ntu.edu.sg.

**Lihua XIE** received the B.E. and M.E. degrees in electrical engineering from Nanjing University of Science and Technology in 1983 and 1986, respectively, and the Ph.D. degree in electrical engineering from the University of Newcastle, Australia, in 1992. Since 1992, he has been with the School of Electrical and Electronic Engineering, Nanyang Technological University, Singapore, where he is currently a professor and served as the Head of Division of Control and Instrumentation from July 2011 to June 2014. He held teaching appointments in the Department of Automatic Control, Nanjing University of Science and Technology from 1986 to 1989. Dr Xie's research interests include robust control and estimation, networked control systems, multi-agent networks, and unmanned systems. He has served as an Editor-in-Chief of Unmanned Systems, an editor of IET Book Series in Control and an Associate Editor of a number of journals including IEEE Transactions on Automatic Control, Automatica, IEEE Transactions on Control Systems Technology, and IEEE Transactions on Circuits and Systems II. Dr Xie is a Fellow of IEEE and Fellow of IFAC. E-mail: elhxie@e.ntu.edu.sg.

**Karl Henrik JOHANSSON** is Director of the ACCESS Linnaeus Centre and Professor at the School of Electrical Engineering, KTH Royal Institute of Technology, Sweden. He is a Wallenberg Scholar and has held a Senior Researcher Position with the Swedish Research Council. He also heads the Stockholm Strategic Research Area ICT The Next Generation. He received MSc and PhD degrees in Electrical Engineering from Lund University. He has held visiting positions at UC Berkeley, California Institute of Technology, Nanyang Technological University, and Institute of Advanced Studies, Hong Kong University of Science and Technology. His research interests are in networked control systems, cyber-physical systems, and applications in transportation, energy, and automation systems. He has been a member of the IEEE Control Systems Society Board of Governors and the Chair of the IFAC Technical Committee on Networked Systems. He has been on the Editorial Boards of several journals, including Automatica, IEEE Transactions on Automatic Control, and IET Control Theory and Applications. He is currently a Senior Editor of IEEE Transactions on Control of Network Systems and Associate Editor of European Journal of Control. He has been Guest Editor for a special issue of IEEE Transactions on Automatic Control on cyber-physical systems and one of IEEE Control Systems Magazine on cyber-physical security. He was the General Chair of the ACM/IEEE Cyber-Physical Systems Week 2010 in Stockholm and IPC Chair of many conferences. He has served on the Executive Committees of several European research projects in the area of networked embedded systems. He received the Best Paper Award of the IEEE International Conference on Mobile Ad-hoc and Sensor Sys-

tems in 2009 and the Best Theory Paper Award of the World Congress on Intelligent Control and Automation in 2014. In 2009 he was awarded Wallenberg Scholar, as one of the first ten scholars from all sciences, by the Knut and Alice Wallenberg Foundation. He was awarded Future Research Leader from the Swedish Foundation for Strategic Research in

2005. He received the triennial Young Author Prize from IFAC in 1996 and the Peccei Award from the International Institute of System Analysis, Austria, in 1993. He received Young Researcher Awards from Scania in 1996 and from Ericsson in 1998 and 1999. He is a Fellow of the IEEE. E-mail: kallej@ee.kth.se.